


Appendix B

Fire Alarm and Evacuation Strategy

The fire alarm is to BS 5389, 1.2002, and is an L1 system. The evacuation strategy is for a full evacuation of both floors / all areas when an alarm is raised.

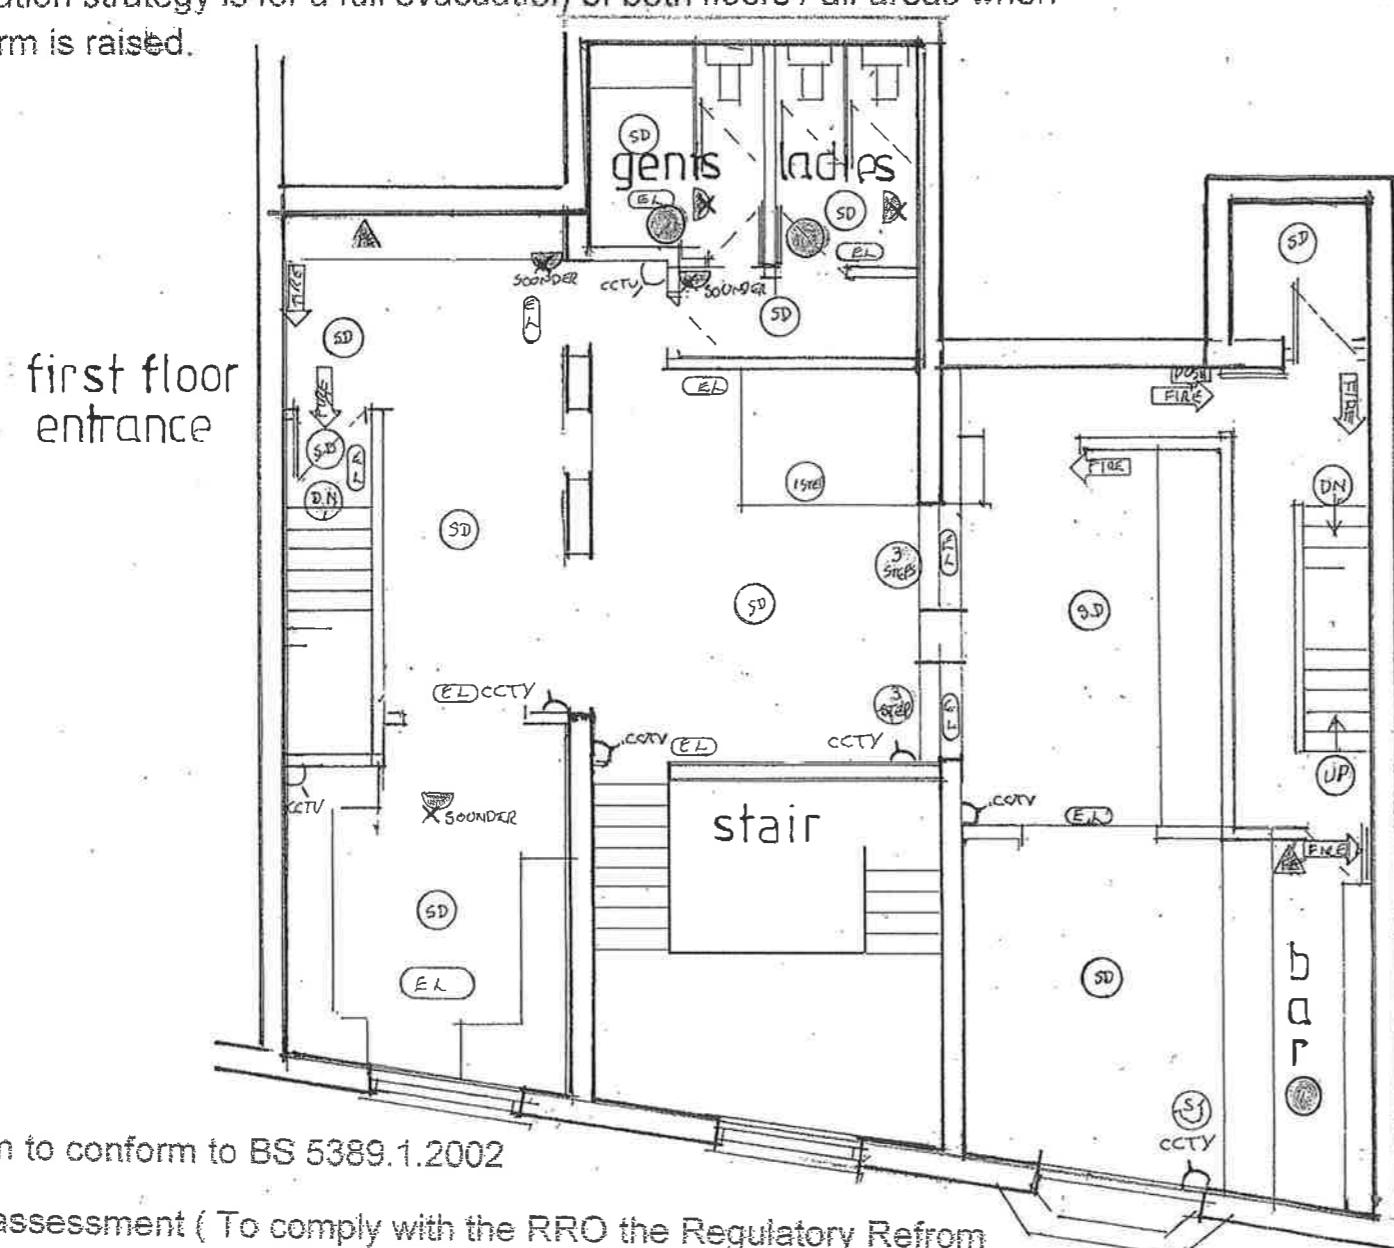

Fire alarm to conform to BS 5389.1.2002

Fire risk assessment (To comply with the RRO the Regulatory Reform Order 2009)

- (SP) - smoke detector
 - (EES) - illuminated fire exit sign
 - (EL) - emergency light
 - (A) - fire extinguisher
 - (S) - sounder

Emergency Lighting to BS 5266.1:1999

Battery maintained emergency lighting over all exit doors

• Notes for licensing purposes

- Red outline - Extent of premises outlined in red. See also Ordnance Survey site plan.
 - Red - The location of points of access and egress from the property.
 - Orange - Licensing activity relating to the sale of alcohol, location fire exit of bars for the sale of and consumption of alcohol.
 - Yellow - Steps, stairs and changes in levels.
 - Blue - Toilet facilities for the public use.
 - Purple - Location of fire fighting equipment
 - 1. Fire safety equipment
 - 2. Fire extinguishers
 - 3. Fire doors
 - 4. Alarms
 - Green - Kitchen location and food preparation for the public areas.

Licensing areas for the premises known as **Zanzi**

4-8 Guildhall Wall

Portsmouth