



Appendix B

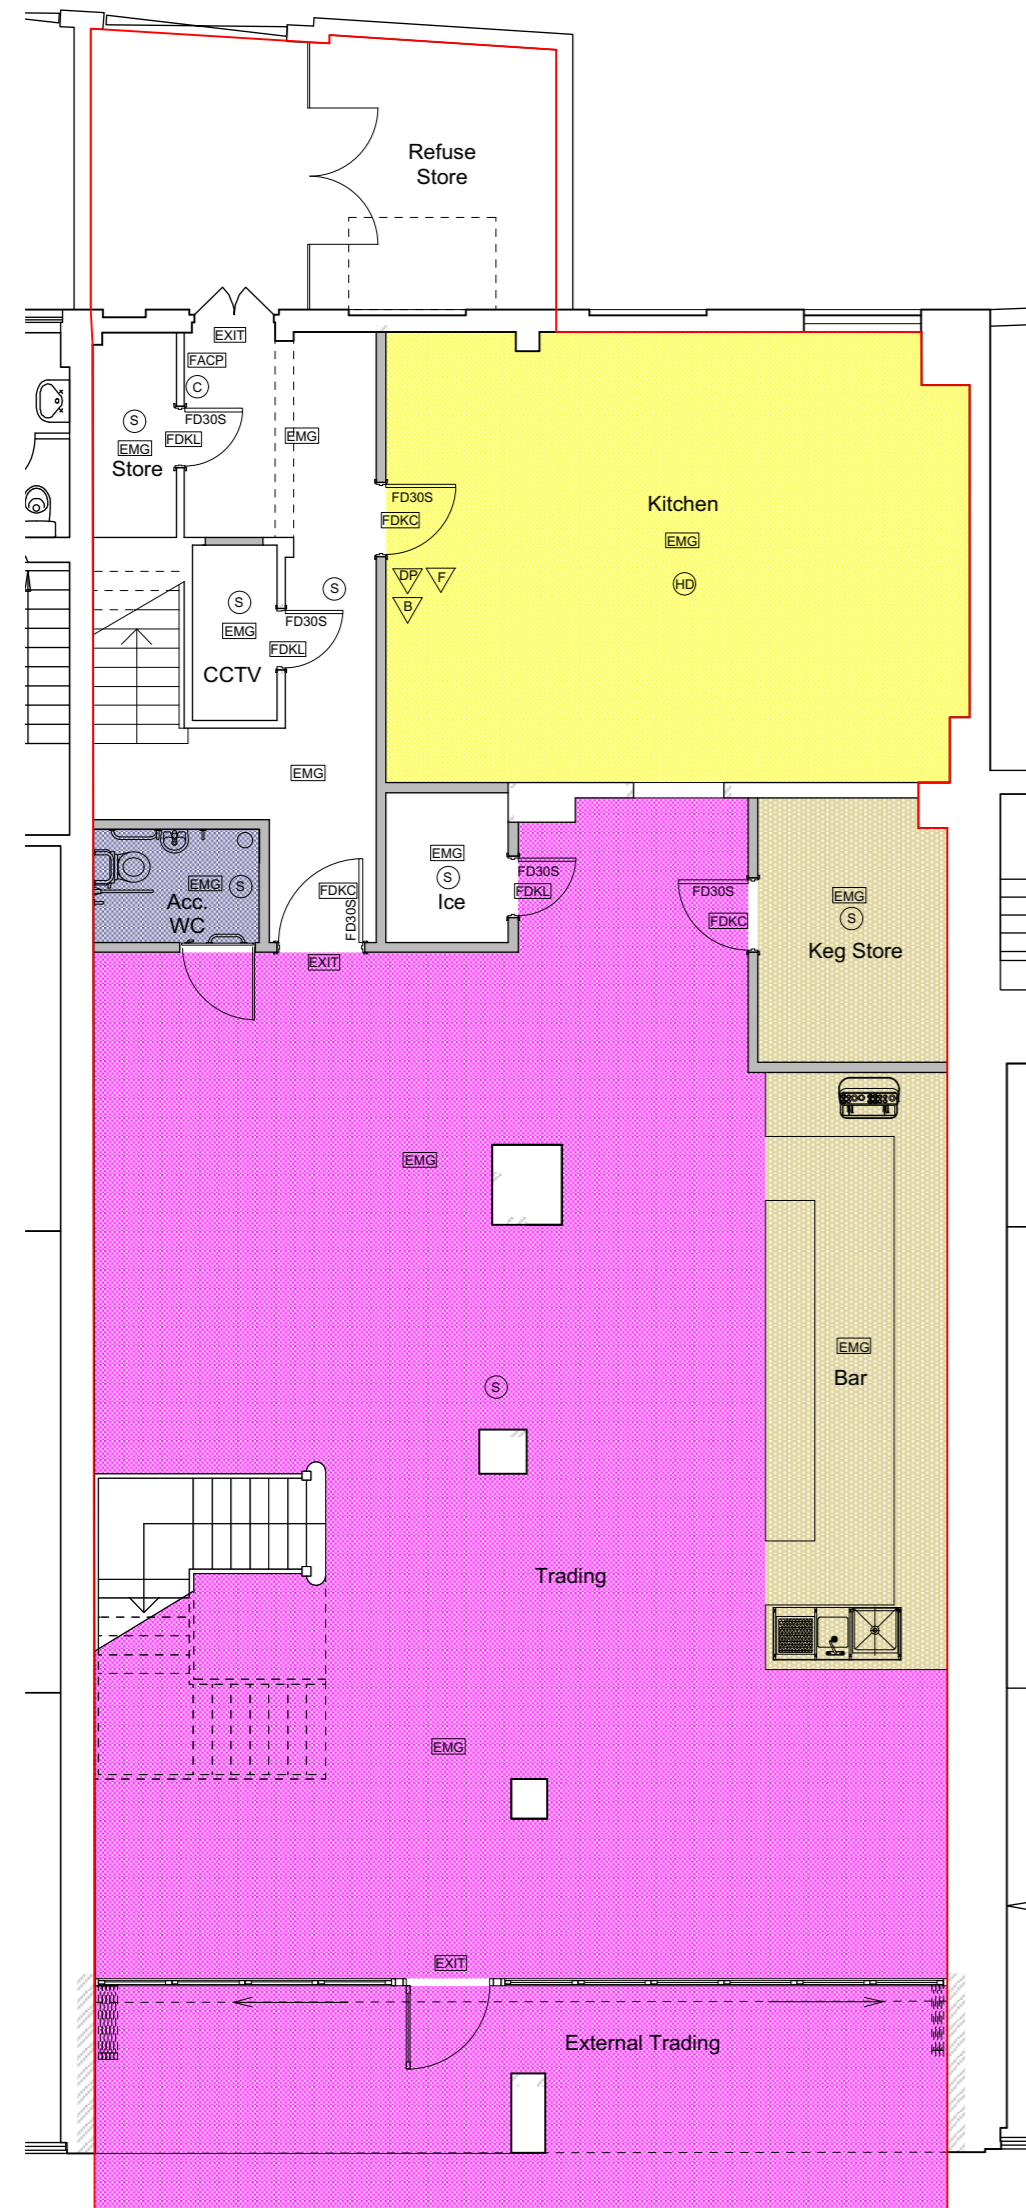

GROUND FLOOR PLAN

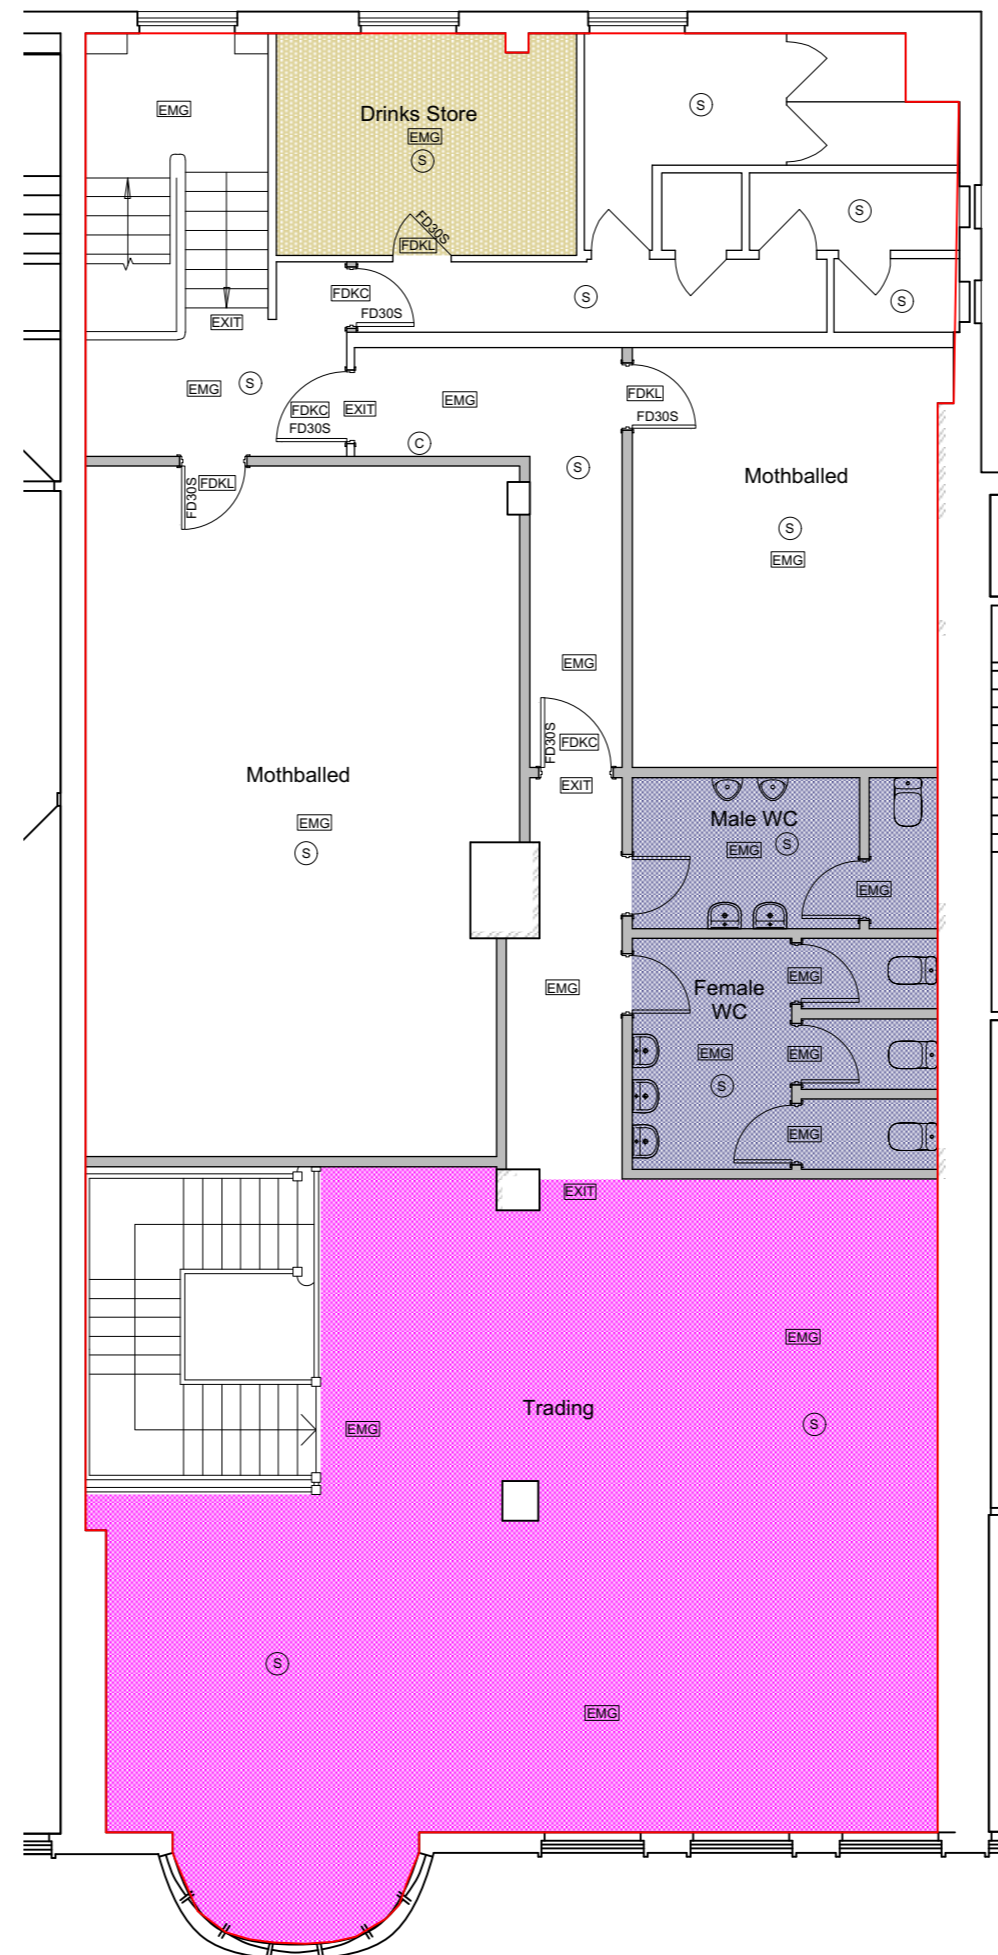

FIRST FLOOR PLAN

LICENSING KEY:

EXIT Illuminated Fire Exit sign	FACP Fire Alarm Control Panel
C Break glass call point for fire alarm in accordance with BS5839	SD Smoke detector
FD30 Fire door to provide min. 30 minutes fire protection	S Smoke detector/alarm
FD30S Fire door to provide min. 30 minutes fire protection and where restricted smoke leakage at ambient temperatures is needed.	HD Heat detector
Area for consumption of intoxicating liquor	Alarm sounder
Area for storage of liquor/bar counter	EMG Emergency lighting in accordance with BS5266
Toilet accommodation	B Fire blanket 1m x 1m unless otherwise stated
Kitchen & staff areas	F 6 litre fire foam extinguisher
	DP 10kg dry powder fire extinguisher
	Total extent of licensed premises

Rev Date Initials Details

Purpose of Issue

LICENSING APPLICATION

RICHARD PEDLAR ARCHITECTS
ARCHITECTURE • CONSERVATION • URBAN DESIGN

RPCA 4 Grove Road Redland
Bristol BS6 6UJ • 0117 974 2612
www.rpca.co.uk • info@rpca.co.uk



Project Cafe/Bar
Units 36 - 38, Palmerston Road, Southsea

Client Loungers Ltd.

Title Ground & First Floor Plans

Drawing No. LNG3793.02

Scale 1:100 @ A2 Date Nov 2017

Responsibility is not accepted for errors made by others in scaling from this drawing. All construction information to be taken from figured dimensions only.