

**Appendix 3 - Summary of seawater sampling undertaken by Regulatory Services**

Sample Locations -



Weekly samples at:

- Sample point A - Environment Agency monitoring point for Southsea East
- Sample point B - East of South Parade Pier
- Sample point C - East (+1) of Southsea Pier
- Sample point D - East (+2) of Southsea Pier

Additional sampling at point 1 (Opposite Southsea Common) from October onwards -





In addition, monthly samples obtained by vessel (used for the sampling of shellfish for classification purposes). One sample from Portsmouth Harbour and two from Langstone harbour each month.

Bathing water classification criteria -




Classification	Criteria - Calculated statistically with 4 years sampling results
Excellent	E. coli ≤250 cfu/100ml Enterococci ≤100 cfu/100ml
Good	E. coli ≤500 cfu/100ml Enterococci ≤200 cfu/100ml
Sufficient	E. coli ≤500 cfu/100ml Enterococci ≤185 cfu/100ml
Poor	The values are worse than the sufficient

**Appendix 3 - Summary of seawater sampling undertaken by Regulatory Services**

**Results summary**

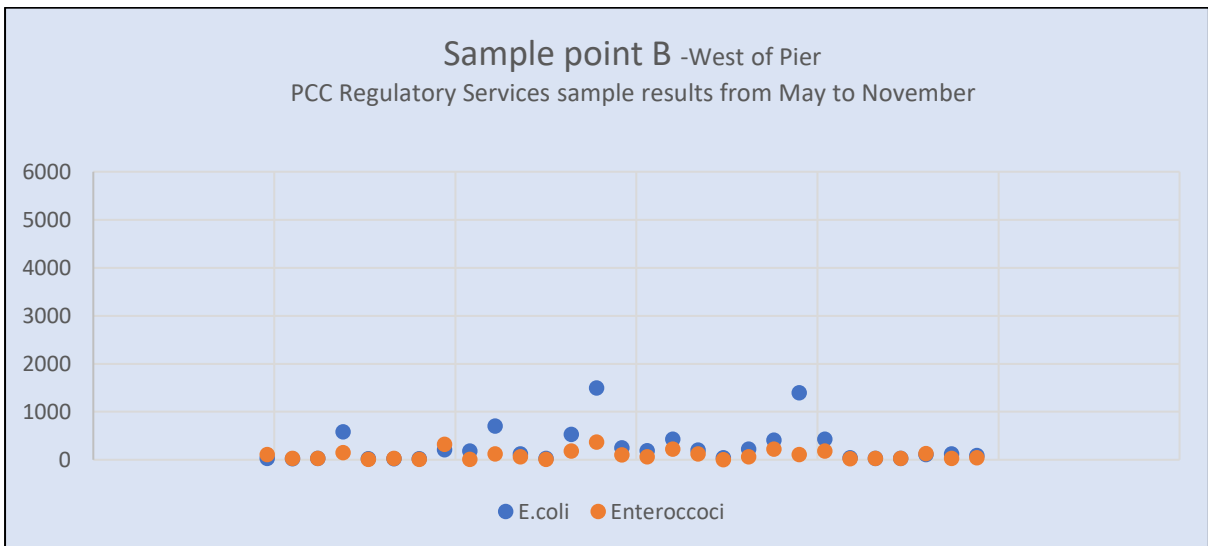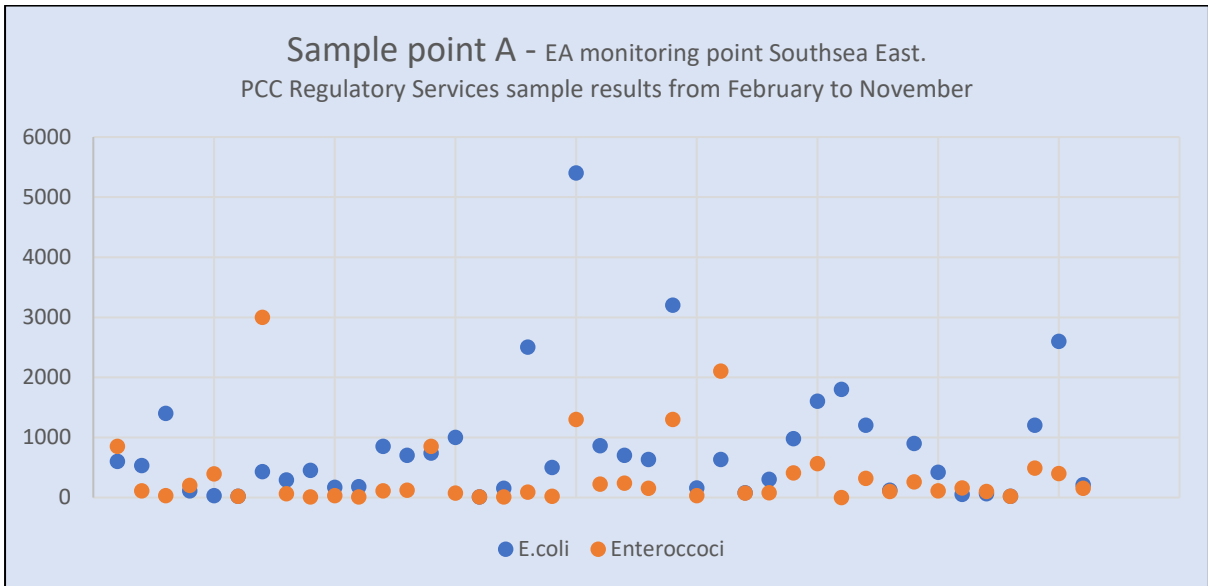

**Appendix 3 - Summary of seawater sampling undertaken by Regulatory Services**

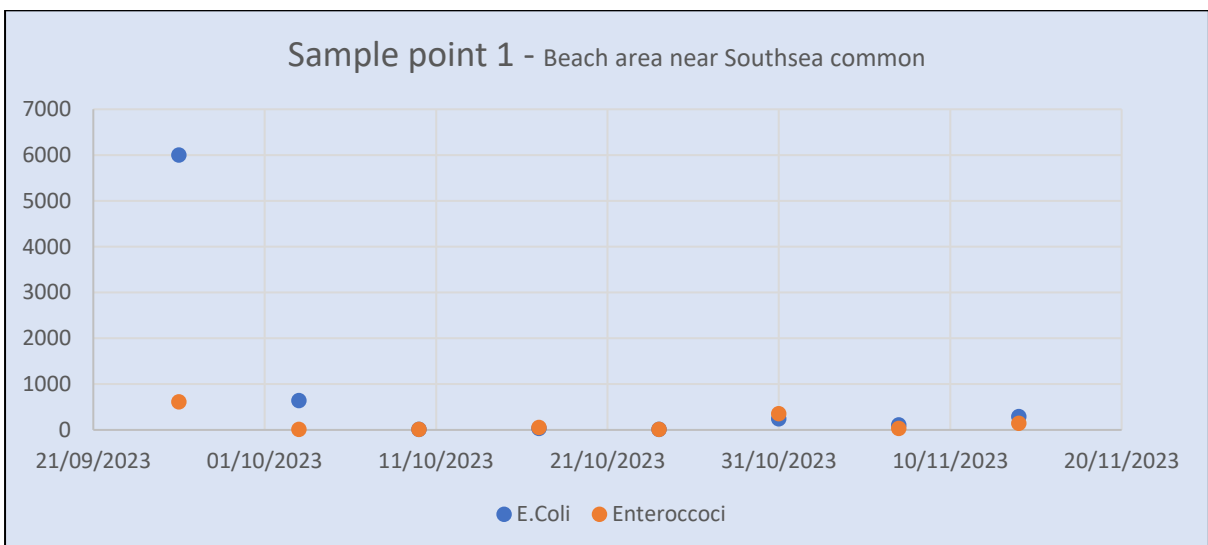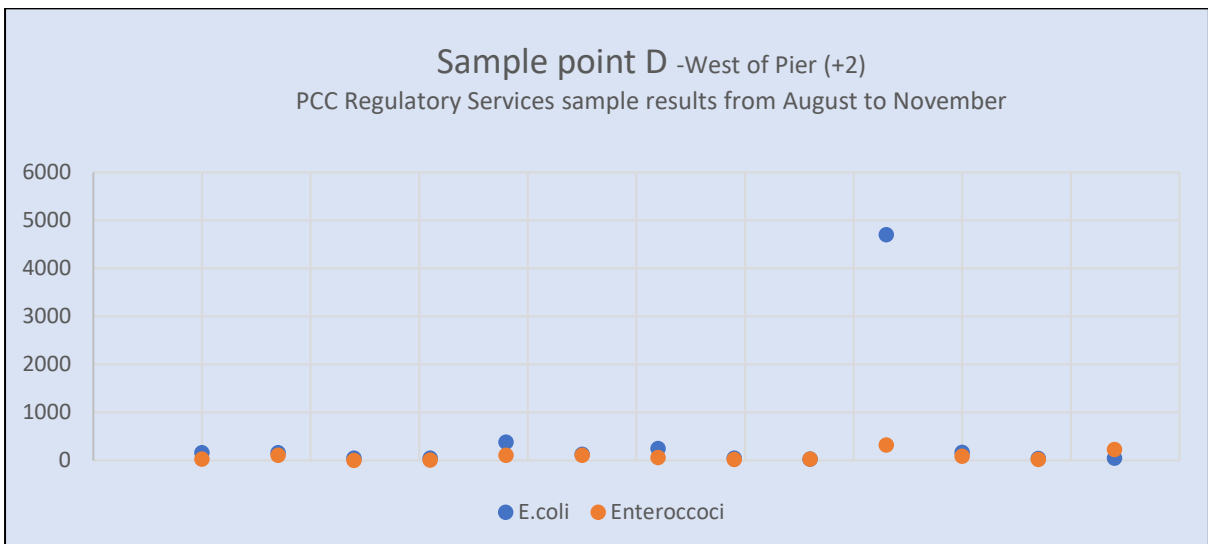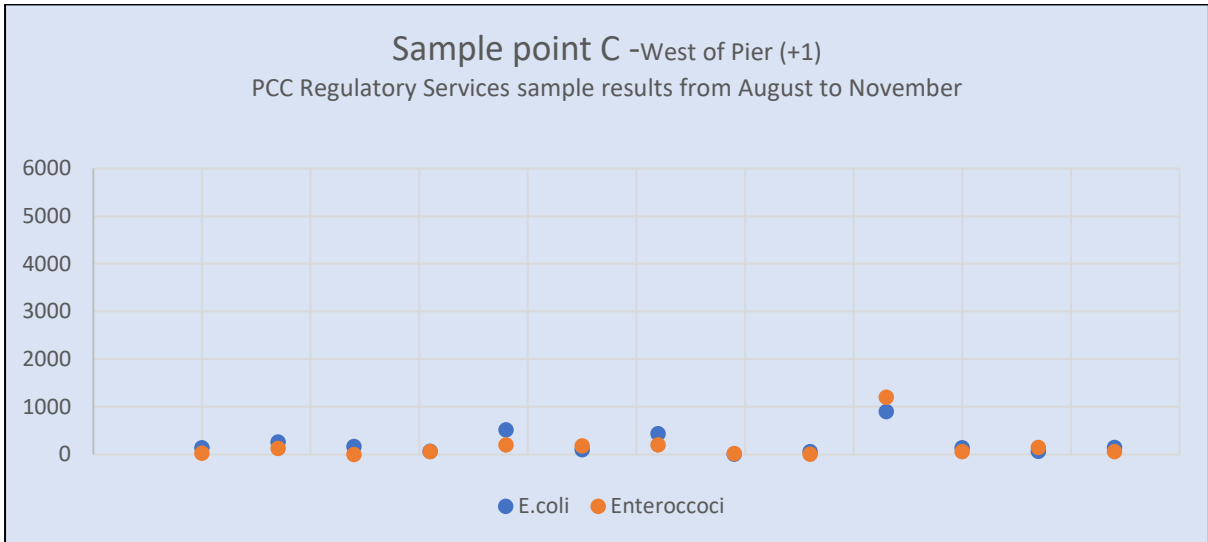

**Appendix 3 - Summary of seawater sampling undertaken by Regulatory Services**

